


Length of 'L'	$(4 \times 'D') + 1m$
Diameter 'D'	VARIABLES
Depth of Rock	400mm

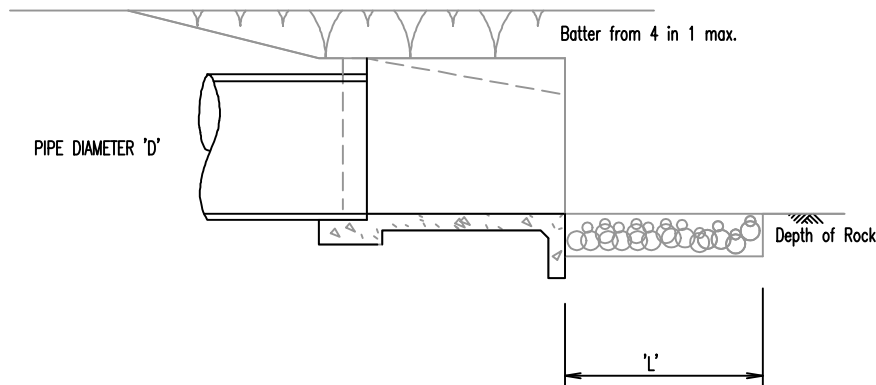

SECTION A-A

NOTES:

1. Geofabric to be placed and witnessed by Council's Superintendent, prior to rock being placed.
2. 100mm - 200mm rock must be used.
3. Where the length 'L' is determined to be too long the RPEQ must design an alternative solution for Council Approval.

B	INDUSTRY STANDARD DRAWINGS WITH DEVELOPMENT MANUAL UPDATE 2018	01/08/2018
A	ORIGINAL ISSUE	1/3/97
	REVISIONS	DATE



Email: info@whitsundayrc.qld.gov.au Web: www.whitsundayrc.qld.gov.au

BOWEN
67 Herbert St
Bowen 4805 Q
Ph 07 4761 3600

COLLINSVILLE
Cnr Stanley & Conway Sts
Collinsville 4804 Q
Ph 07 4785 5366

PROSERPINE
83-85 Main St
Proserpine 4800 Q
Ph 07 4945 0200

HEADWALL ENTRY/EXIT
RIPRAP ROCK TREATMENT

DRAINAGE
Standard
Drawing
D-0002

A	B			
---	---	--	--	--